

# Type Approval Certificate



This is to certify that the undernoted product(s) has/have been tested in accordance with the relevant requirements of the GL Type Approval System.

Certificate No. **99 499 - 97 HH**  
Company **ABB France**  
**10, Rue Ampere**  
**69685 Chassieu Cedex, FRANCE**

Product Description **Power contactors**

Type **A50, A63, A75**

Environmental Category **C**

Technical Data / Range of Application	A50	A63	A75
Maximum Rated voltage Ue:	1000 V AC	1000 V AC	1000 V AC
Rated frequency:	50/60 Hz	50/60 Hz	50/60 Hz
Rated insulation voltage:	1000 V	1000 V	1000 V
Main contacts			
Rated op. current Ie (AC1, 40°C):	100 A	115 A	125 A
Rated operational load			
utilization category AC3 (400 V):	22,0 kW	30,0 kW	37,0 kW
utilization category AC3 (690 V):	30,0 kW	37,0 kW	40,0 kW
utilization category AC3 (1000 V):	30,0 kW	33,0 kW	37,0 kW
Auxiliary contacts			
Rated insulation voltage:	690 V	690 V	690 V
Thermal current rating:	16A	16 A	16 A

Accessories: as listed in technical data sheet.

Test Standard **Regulations for the Performance of Type Tests (2003),  
IEC 60947-4-1:2009 Ed. 3**

Documents **Test reports : CB Certificate FR602227A dated 2010-11-26**  
**Technical data sheet: 1SBC100122C0202**

Remarks **None**

Valid until **2016-10-03**

Page **1 of 1**

File No. **I.K.03**

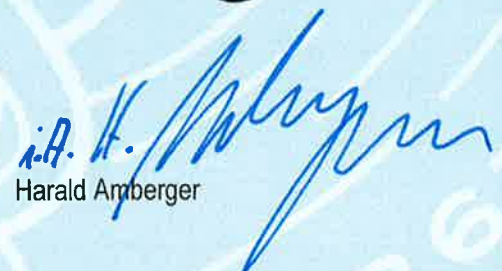
Hamburg, **2011-10-04**

Type Approval Symbol



**Germanischer Lloyd**

  
Christoph Kutzner

  
Harald Amberger

This certificate is issued on the basis of "Guidelines for the Performance of Type Approvals Part 1, Procedure".