

Notice 1

The information in this document is subject to change without notice and should not be construed as a commitment by ABB. ABB assumes no responsibility for any error that may occur in this document.

Notice 2

This document complies with the program revision v. 4.0.3.

Notice 3

Additional information such as Release Notes and Last Minute Remarks can be found on the program distribution media.

Trademarks

Microsoft is a trademark of Microsoft Corporation.

Windows NT is a trademark of Microsoft Corporation.

LONWORKS is registered trademark of Echelon Corporation.

Other brand or product names are trademarks or registered trademarks of their respective holders.

All Microsoft products referenced in this document are either trademarks or registered trademarks of Microsoft Corporation.

Contents

	Page
1 Introduction.....	5
1.1 Reference documentation.....	5
1.2 Safety Instruction.....	5
1.3 General about LIB 500 Base and LIB 510.....	5
1.4 Application Pictures	6
1.5 Process Picture (Station)	7
1.6 Picture Layout.....	8
1.6.1 Overview	8
1.6.2 Alarm Indication.....	9
1.6.3 Alarm Row	9
1.6.4 Information Bar	10
1.6.5 Note Marker.....	10
1.7 Push Buttons in the Picture Layout.....	11
1.8 Pull-Down Menus in the Picture Header	12
1.8.1 Standard Menu Part	13
1.8.1.1 Main Menu Functions.....	13
1.8.1.2 Options Menu Functions	14
1.8.1.3 Engineering Menu Functions.....	14
1.8.1.4 Reports Menu Functions	15
1.8.1.5 Stations Menu Functions.....	16
1.8.1.6 Simulation Menu Functions	16
1.8.2 Picture Specific Menu Part	17
1.8.2.1 Tools Menu Functions.....	17
1.8.3 Help Menu Part.....	17
1.8.3.1 Help Menu Functions	17
1.9 Process Lists	18
1.10 Reports.....	18
1.11 Tools.....	18

1.12 Application Window	19
1.13 Opening an Application Window	19
1.13.1 User Login	20
1.13.2 Authorization	21
1.13.3 Closing	22
1.14 Shifting Pictures on Screen	22
1.14.1 Navigating in the Pull-Down Menus	23
1.15 Basic Handling of Application Pictures	25
1.15.1 General	25
1.15.2 Push Buttons	25
1.15.3 Folder	27
1.15.4 Selecting Options	27
1.15.5 Scroll Folders Arrow Buttons	28
1.15.6 Entering Data	28
1.15.7 Moving Dialogs	29
1.15.8 Viewing HELP Texts	30
1.15.9 Inquiring Picture Name	30
1.16 Some Terms Used in the Operator's Manual	31

1 Introduction

The intention with this chapter is to give an introduction into LIB 500 BASE and LIB 510 functions. The functions are to some parts described in more detail.

Two separate phases can be identified:

1. Engineering phase, when configuring the application by means of the system tools.
2. The “runtime” phase, when the prepared and configured application is used and connected to the process.

This Operator's Manual does not deal with phase 1, focus is set on using the LIB 500 BASE and LIB 510 related functionality after a proper configuration.

However, as the user you may notice that all application areas and functionality provided by LIB 500 BASE and LIB 510 described in this Operator's Manual are not covered by your application, because the functionality of individual applications is designed according to the needs of the user. Or vice versa, your application may feature functionality that is not described in the scope of this Operator's Manual.

1.1 Reference documentation

Handling of LIB 500 is divided into two operator's manuals. For LIB 510 please see LIB 510 4.0.3 Operator's Manual 1MRS 751281-MUM.

1.2 Safety Instruction



It is strongly recommended to become familiar with the basic handling of functionality in the application pictures and picture functions in order to avoid situations that may cause danger to the personnel. Therefore, the use of authorization levels is advisable, in order to allow only dedicated personnel to perform control operations of e.g. switching devices.

1.3 General about LIB 500 Base and LIB 510

LIB 500 BASE consists of basic functions needed for application handling (e.g. backbone, user management, event and alarm list, busbar coloring). Furthermore, LIB 500 is the platform to which support packages are added to, e.g. LIB 510. LIB 510 is a support package containing functionality such as MV process, procedures for handling relays and terminals (SPACOM and RED), tools needed for configuring the process terminals or for e.g. uploading of recordings from the disturbance recorders etc.

1.4 Application Pictures



Figure 1. Examples of application pictures

Figure 1 is composed of some examples of application pictures. In this case an alarm list, trend report, harmonic violation period bars provided by the PQ-Monitoring Tool, and a daily report from the Measurement Reports 2 are displayed.

Application pictures visualise the processes that are supervised. There are many different types of application pictures; single line diagrams, process pictures, system supervision, lists, application tools, measurement reports, and trend reports.

When a picture is presented on the screen, you first see the picture background. Then the start program is executed. The start program may imply that windows are displayed, contact is taken to the process database, the picture process objects are given initial values etc. The start program cannot be interrupted by pressing any function key.

Generally, only one application picture is presented within the same monitor. Opening another function closes or hides the previous one. However, several monitors can be opened to the same application. Thereby the same application pictures or different application picture can be shown in different places at the same time. If two or more monitors are open to the same application processes and viewing/using the LIB 500 BASE and LIB 510 functions are settled by the user's authorization level.

Your application may contain one or more application or process pictures, which can be accessed from the pull down menus.

1.5 Process Picture (Station)

Figure 2 shows an example of a station (process) picture in a form of a single line diagram. The MV processes can generally be shown in the process picture by different representations, but the representation to be used is selected during the picture configuration phase. Different colors are normally used for indicating status, but also to indicate whether an object is connected to the process or not etc.

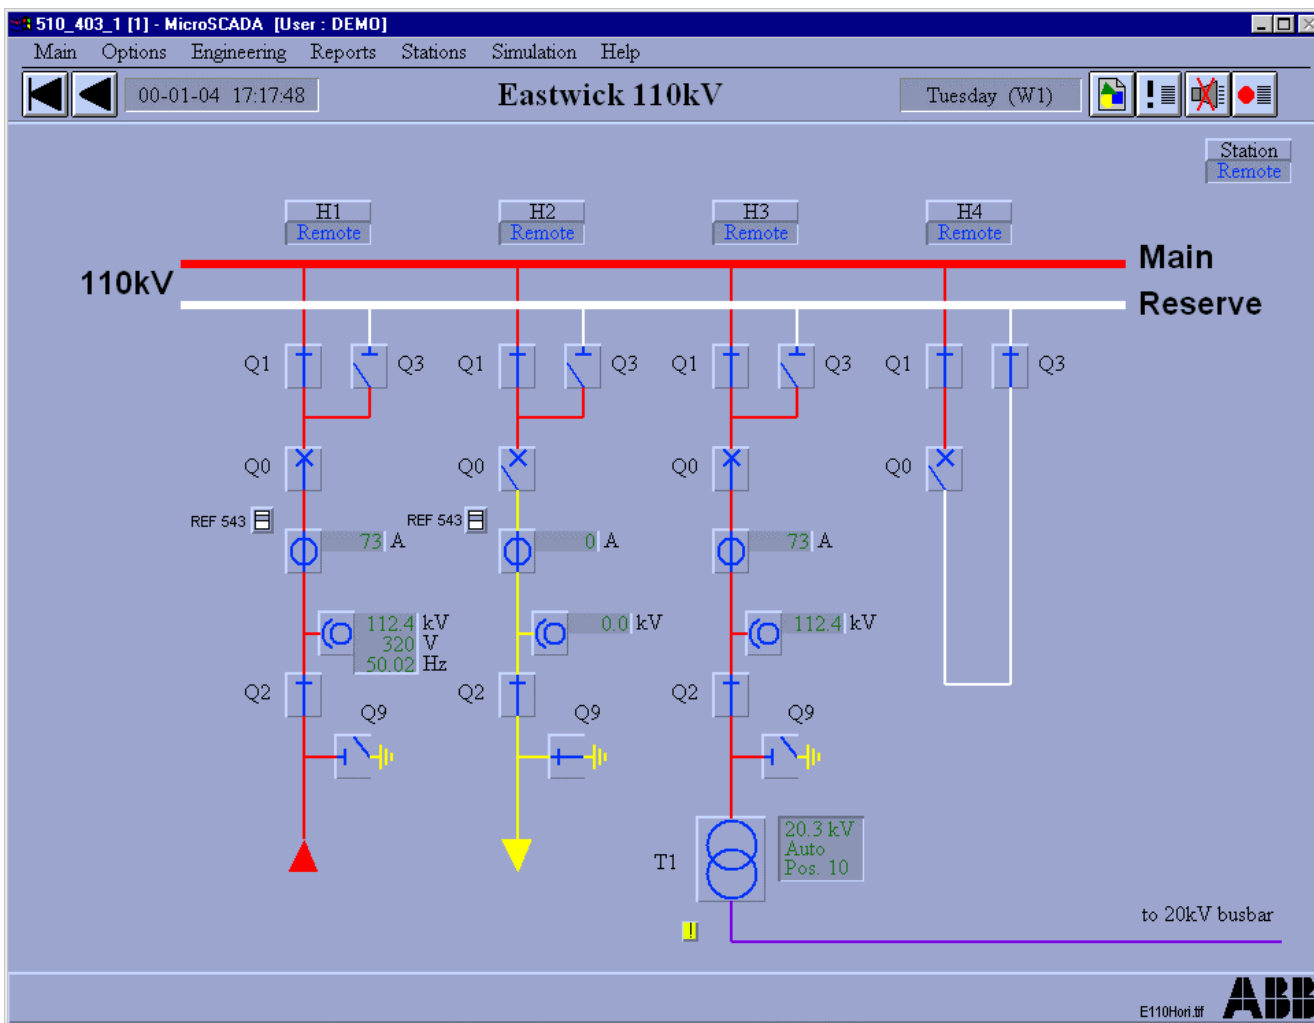


Figure 2. An example of processes in form of a single line diagram in a process picture (station picture)

1.6 Picture Layout

1.6.1 Overview

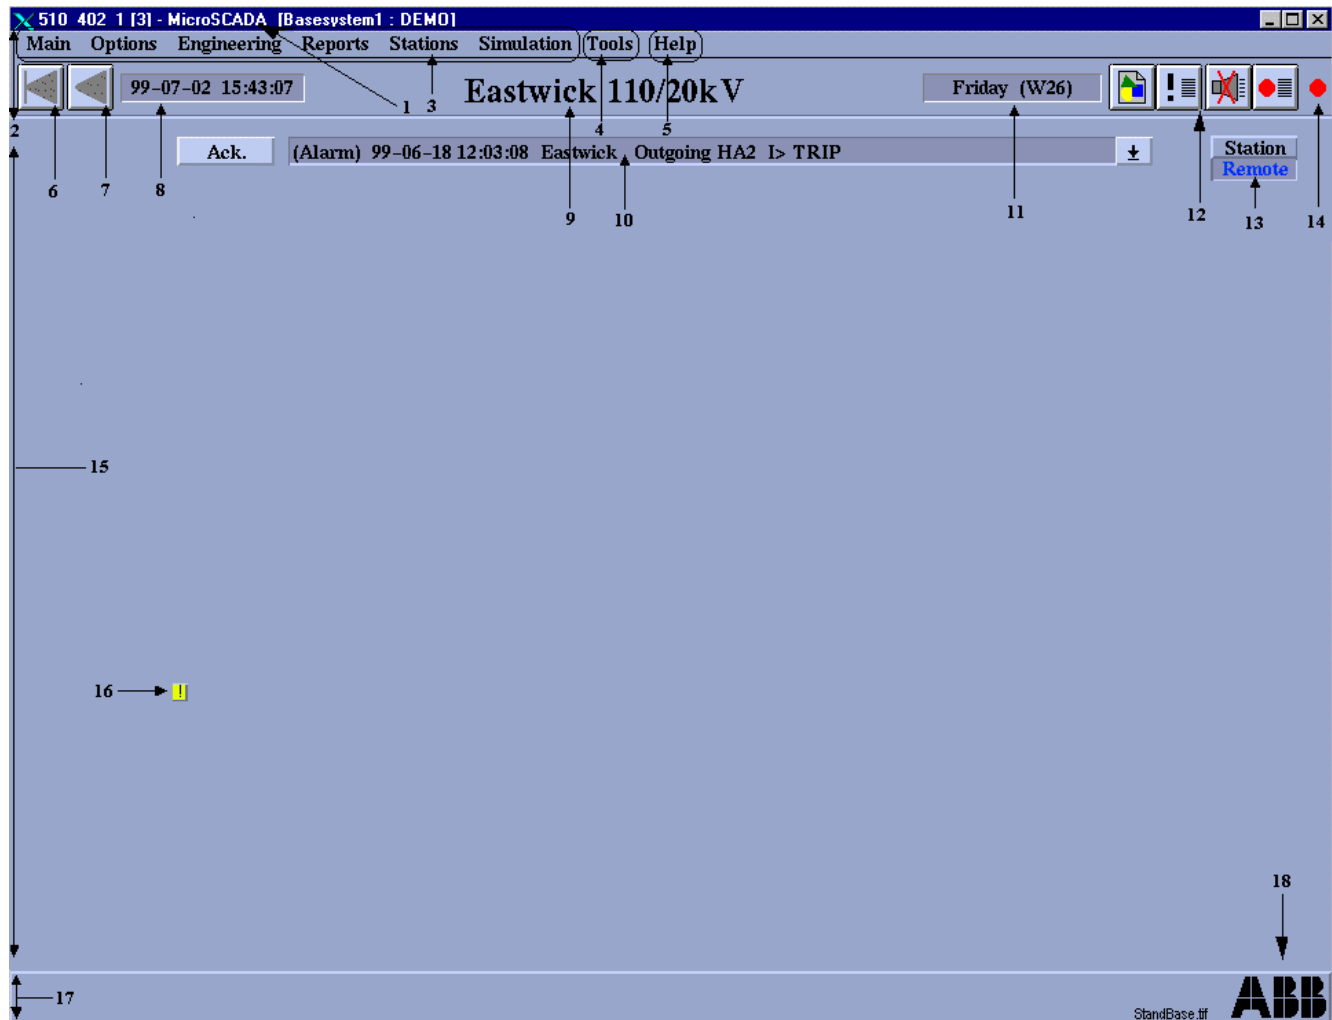


Figure 3. Picture layout items

1. Application Name, Computer Name and User Name
2. Picture Header
3. Standard Menu Part
4. Picture Specific Menu Part
5. Help Menu Part
6. First Picture
7. Previous Picture
8. Date and Time
9. Picture Name

- 10.Latest unacknowledged alarm
- 11.Day and Week
- 12.Shortcut buttons for Hard Copy, Event List, Audio Alarm Acknowledgement, Alarm List
- 13.Station Symbol
- 14.Alarm Indication (blinking)
- 15.Picture Specific Area
- 16.Note Marker
- 17.Information Bar
- 18.ABB Logo

Table 1 Figure 3 can be divided into two sections

Section	Remarks
Picture header	Normally the same for different application pictures
Picture specific area	Specific for the process viewed or the application picture opened.


There are three types of pull-down menus:

	Menu type	Remarks
1	Standard Menu Part	Contains standard menu functions, which normally are the same within the application.
2	Picture Specific Menu Part	Picture specific menu functions. The menus and menu items are different from one application picture to another, or not available in all pictures. The Tools menu is a typical example.
3	Help Menu Part	Contains system messages and representation symbols.

The meaning of the notifications in Figure 3 is mostly self-evident, but the following sections give further information regarding some items in Figure 3.

1.6.2

Alarm Indication

A red flashing alarm bullet  is presented at the right of the header bar when there are unacknowledged alarms present in the system. Acknowledging of the alarm turns the flashing red bullet into a red bullet with steady light, provided that there are more alarms.

1.6.3

Alarm Row




Figure 4. Alarm row informing that there has been a trip due to overcurrent

Below the header, an alarm row appears when an alarm is active. The alarm indication, which provides information of the alarm, is displayed blinking until the alarm is acknowledged or a new alarm is activated.

The alarm row gives the operator a quick notification of an alarming event in the system. The advantage is not only that it can be noticed easily, it also instantly tells the operator what has happened and where. With the alarm row the alarms can easily be acknowledged.

The alarm row also contains other unacknowledged active and inactive alarms in the system. The latest alarm is shown on the top of the list. Any of the alarms shown on the list can be selected to be acknowledged.

The user's authorization level has to be at least Control (1) before alarms can be acknowledged. (The alarm row uses authorization group ALARM_HANDLING.)

On the alarm row, active and inactive alarms are separated by showing the alarm text in parenthesis (Alarm) if the alarm is inactive. Thereafter, the date and time of the alarm and the object text of the alarming object are presented.

1.6.4

Information Bar

A blue horizontal bar with yellow text that reads "The breaker dialog time-out has expired!".

Figure 5. The information above tells that the dialog for operating the breaker was closed after a certain time of inactivity by the user.

The information bar located at the lowest part of the application picture informs about e.g. ongoing processes or progress of the process, when no object specific dialog is available.


The information bar also informs about possible SCIL status messages that might occur. The Help pull down menu contains more information about the elapsed events, and also a log book.

A new system message or SCIL status code replaces the previous one.

Information on the information bar is reset by clicking it with the mouse. The SCIL status messages are still available from the HELP pull down menu.

1.6.5

Note Marker

The note marker  is used for writing notes, and it is also readable by other users. The note marker is application picture specific, which means that when opening the same view into another monitor, the same note marker is presented. As many note markers as needed may be used. A note marker is opened by clicking it with the mouse.

1.7 Push Buttons in the Picture Layout

Push buttons in the picture layout are buttons that can be activated during run mode, (click by mouse).

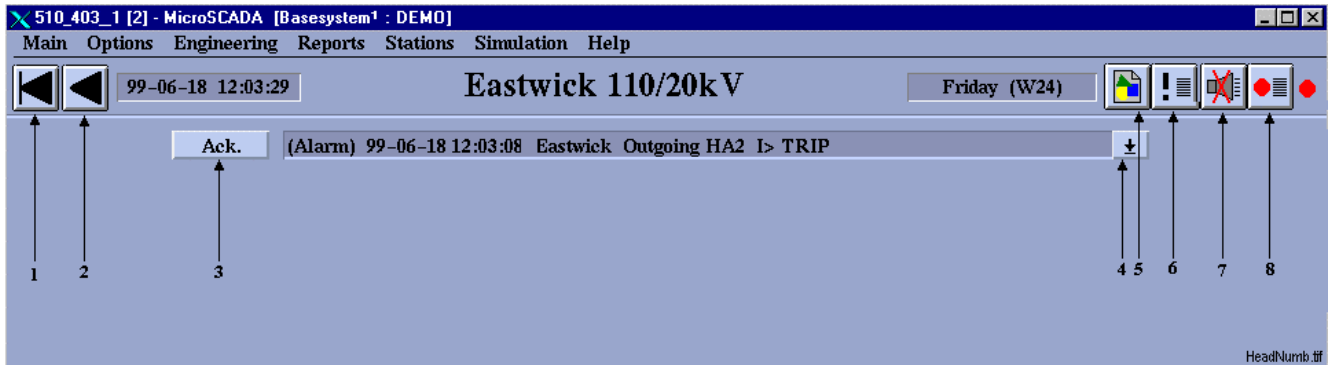


Figure 6. Picture layout push buttons

Push button Number	Function	Remarks
1	Shortcut to the first picture	The first picture, shown after login
2	Shortcut to previous picture	The previous picture opened.
3	Acknowledge Alarms	Pops up when the alarm bar appears
4	Scroll in the Alarm List	Scroll unacknowledged alarms
5	Shortcut to the Hard Copy	A hard copy of the active MicroSCADA window will be printed out by clicking the hard copy button in the upper right corner of the VS-header
6	Shortcut to the Event List	
7	Shortcut to the Audio Alarm Acknowledgement	Audible alarms coming from a MicroSCADA alarm unit will be acknowledged by clicking the Acknowledge audible alarms button in the upper right corner of the VS-header.
8	Shortcut to the Alarm List	

1.8

Pull-Down Menus in the Picture Header

Figure 7. Picture header pull down menus

This section describes the pull down menus, and some menu functions in more detail. This section cannot predict all tailor-made pull-down menu configurations. Therefore, the focus is set on the pull-down menus that are implemented in most cases.

Navigation between application pictures in the application is performed by using the pull-down menus, and hence, direct access to all pictures/views in the system is enabled.

Some menu items in the menu might be unavailable when some other view than the main view is open, or the menu item has not been configured during the system configuration. The menu can also be configured to contain other menu items than described in this section. This section explains the basic menus and some optional alternatives. The application may, however, contain several customised menus and menu items.

LIB 500/510 based applications provide a hierarchical menu structure. This menu is mainly common to all application pictures. Some of the menu items in the main menu, e.g. the Event List, Alarm List, DR-Collector Tool, include an additional picture specific Tools menu.

Pull-down menus	Function
MAIN	Login, Previous picture and End session are the default options.
OPTIONS	Produces a menu with assistant pictures, e.g. user management, trend basket and system tools
ENGINEERING	Displays the tool manager, i.e. the menu to the engineering and system handling tools.
REPORTS	Provides various lists.
STATIONS	Displays the station menu. Contents are Station authority and configured station pictures, which also can be dedicated the authentic names of the process to open.
SIMULATION	This is an example of an additional menu that is added to the main menu part. It enables simulating of processes and operations.
TOOLS	The Tools menu is an example of an picture specific menu.
HELP	System messages and representation symbols used for the process pictures

1.8.1 Standard Menu Part

1.8.1.1 Main Menu Functions




Figure 8. The Main pull down menu

Menu item	Explanation
Login	Used for login and logout for authorised users.
Previous Picture	Takes the user back to previous picture.
End Session	Ends the session and the monitor is closed.

Login Dialog

This Login dialog is started from the Main pull-down menu and by selecting LOGIN. Another automatic login session is started when entering the system at start-up, while this login is available when the application is already running.

The login dialog is for preventing unauthorised persons from making operations to the actual process. The login determines the authorities of the user to be used in the system.

Functionality

The user can insert a user name and a password to the fields and if the user is defined and the password is correct, then the actual application is opened when login is selected.

When the application is entered the very first time, the user logging in is made to be the system manager. The system manager is the only user that can define other users and their authorization levels. The system manager cannot be removed afterwards. (**NOTE!** the user name may not include special characters and it may not contain two letters followed by a number. The name may not begin with a number.) The login and authorization mechanism can also be set out of use by the system manager.

1.8.1.2 Options Menu Functions



Figure 9. The pull down Options menu

Menu item	Explanation
Settings	Menu item for change or view of Application owner, First picture shown after login, Application logo picture, System location, System name, Product info, Lockout duration, Language settings, Daylight Saving time, Process control, Show object ID, HD space alarm, Report Settings, Switch device presentation.
User Management	Menu item for change of a User's profile, password or adding/removing users.
Calendar	Menu item that starts the calendar program. It is used for defining features, activities or command procedures to be performed on a certain day, or several.
Supervision Log	The Supervision Log Viewer is used to monitor information that has been collected by the System Self Supervision and the NT operating system. These files contain information in form of events coming from both hardware and software. For more information, see LIB 500 Base 4.0.3 Operator's Manual (1MRS751278-MUM), System Self Supervision Operator's Manual.
Disturbance Recorder Tools	This submenu contains the items DR-Collector Tool and HV/Collect. DR-Collector Tool is a disturbance recorder tool used in LIB 510/MicroSCADA, CAP 501, CAP 505, and in SMS 510 environments. HV/Collect is used for disturbance uploading function for high-voltage relays (LIB 520)
Trend Basket	This menu item gives access to the basket function which is a means of gathering objects for display in trends. The basket function is described in a later chapter.
Note Marker	Menu item for access to Note mark dialog for displaying and writing notes. Five different colors can be selected.

1.8.1.3 Engineering Menu Functions



Figure 10. The Engineering pull down menu

Menu item	Explanation
DB Import/Export	Exporting process objects from MicroSCADA database to a file. Importing process objects from a file to MicroSCADA database
Busbar Coloring	Shows the status of the busbar coloring. Busbar coloring can also be stopped.
System Tools	System tools used for configuring the applications and picture functions, used when building the applications with its process pictures.

The DB Import/Export function is described in a specific section in the chapter Application related tools.

1.8.1.4

Reports Menu Functions




Figure 11. The Reports pull down menu

Menu item	Explanation
Event List	Opens the view to the Event List
Alarm List	Opens the view to the Alarm List
Trend List	Opens the view to the Trend List
Meas. Reports	Opens the view to Measurements Reports 2
Blocking List	Opens the view to the Blocking List

All the List functions in the table above are described in their respective manuals in LIB 500 Base 4.0.3 and LIB 510 4.0.3 Operator's and Configuration Manuals.

1.8.1.5 Stations Menu Functions

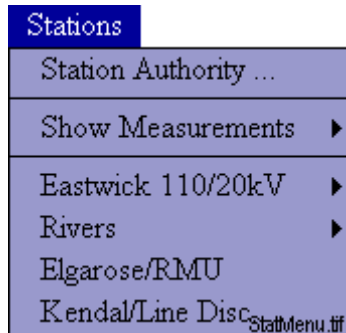


Figure 12. The Stations pull down menu

Menu item	Explanation
Station authority	Defining control centers to control the picture
Show Measurement	Provides an easy and a fast way to monitor the processes in the picture.
Station 1	Opens the view to a defined process picture, unavailable until configured
Station 2	Opens the view to a defined process picture, unavailable until configured

The Stations menu can, of course, contain more than two stations, because this is customer application dependent. Station 1 etc. is normally given a relevant name of the station or process. Returning to the previous screen is done via the button numbered 4 in Figure 3 or, depending on case, the first picture is brought into focus by button number 3 in Figure 3.

1.8.1.6 Simulation Menu Functions

NOTE! The simulation menu is normally included only in the demo application.

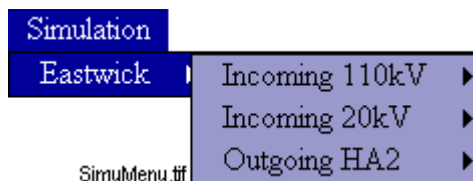


Figure 13. The Simulations pull down menu

Menu item	Explanation
According to configuration	Simulations like overcurrent situations, auto-reclose sequences, tripping of protections etc can be added

In this example the simulation menu is an additional menu of the main menu part.

1.8.2 Picture Specific Menu Part

1.8.2.1 Tools Menu Functions

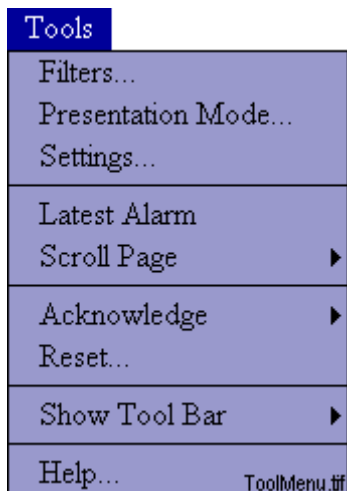


Figure 14. The Tools pull down menu as an example of a picture specific menu part

Menu item	Explanation
Depending on the application picture active.	The contents in the menu is related to the application picture that is open. Trends, Alarm List, Event List, Blocking List etc. all have their own list of menu items in the Tools menu.

The Tools menu in Figure 14 is an example of a picture specific pull-down menu. The Tools menu is available only when some picture has been selected, that is equipped with a dedicated Tools menu. The contents in the Tools menu depends on which tool is active (open). Therefore, there is no generic description of the contents in the Tools menu, the contents is described with the tool concerned in the respective manual.

The Tools menu disappears when the application picture that opened the Tools menu is closed.

1.8.3 Help Menu Part

1.8.3.1 Help Menu Functions



Figure 15. The Help pull down menu

Menu option	Explanation
System message	Works as an aid for system engineering and debugging
Representation	Selectable symbols for switching devices, protection trip and auto reclosing

The Help menu consists of two parts; system messages and representations. The system messages contain a list of messages given by the system. The representations function shows a map over the used symbols for MV process objects and the meaning of used colors.

The System Message dialog is made as an aid for system engineering and debugging. When the dialog is opened, the dialog is updated with information of the SCIL status codes occurred in the particularly picture. The list can be scrolled, if there are more than one SCIL-status code message. The first or oldest status is shown first. If additional statuses occur while the dialog is open, the dialog is refreshed by clicking the Refresh button.

1.9

Process Lists

There are three types of process lists:

Number	Type of list	Explanation
1	Alarm list	Presents the actual alarm state in the process data base
2	Event list	Presents all events reported to the system
3	Blocking list	Presents the blocking situation in the process data base.

Some typical blockings are alarm, event and control blocking. These lists are all described in separate chapters.

1.10

Reports

Reports are used for analysing sampled measurements. The collected data can be presented in a graphical or in a numerical form. Typical reports are energy reports, currents, process disturbance reports (e.g. trippings, earth-faults, overcurrents, auto-reclosures). These reports can be used for analysing fault situations, for improving service and maintenance but also for normal supervision.

1.11

Tools

Tools are used in in order to provide the user with functions adapted to the system. The tools are used for various needs; e.g. system engineering and maintenance, configuration of relay terminals, uploading of disturbance recordings from disturbance recorders etc. The tools are all described in separate sections/chapters.

Example of tools are:

- User Management
- Application Settings

- Database Import/Export
- Login
- RED Relay Tool
- SPA Relay Tool for SPACOM
- DR Collector Tool

1.12 Application Window

An application window is a view or application or process picture that is shown when running MicroSCADA. The application picture examples in section Application pictures, Figure 1, are examples of application windows. Before the user has an access to these application pictures, the user normally has to perform a login.

Normally, the login dialog pops up directly after system start-up. However, it could be worth mentioning the three methods of getting to the stage of opening an application window and the login sequence:

1	Automatic system start-up	Turning on the PC and starting NT automatically starts the MicroSCADA services and the login dialog is shown.
2	Start-up icon	The MicroSCADA session is started from an icon on the PC desktop.
3	Manual start	Manual start of the MicroSCADA services as well as manual opening of a monitor.

Setting up the MicroSCADA system is described in the MicroSCADA installation and System Configuration manuals. That is beyond the scope of this Operator's Manual since it is a question of a system configuration that has to be carried out before starting to use the system on daily basis.

1.13 Opening an Application Window

The first picture displayed after an application window has been opened is an application specific start picture. The start picture generally requires a user login (see below) before the session can continue.

The EXIT button in the start picture and the 'End Session/Yes' in the End Session Information dialog closes the application window. Use these buttons only when you want to end the session.

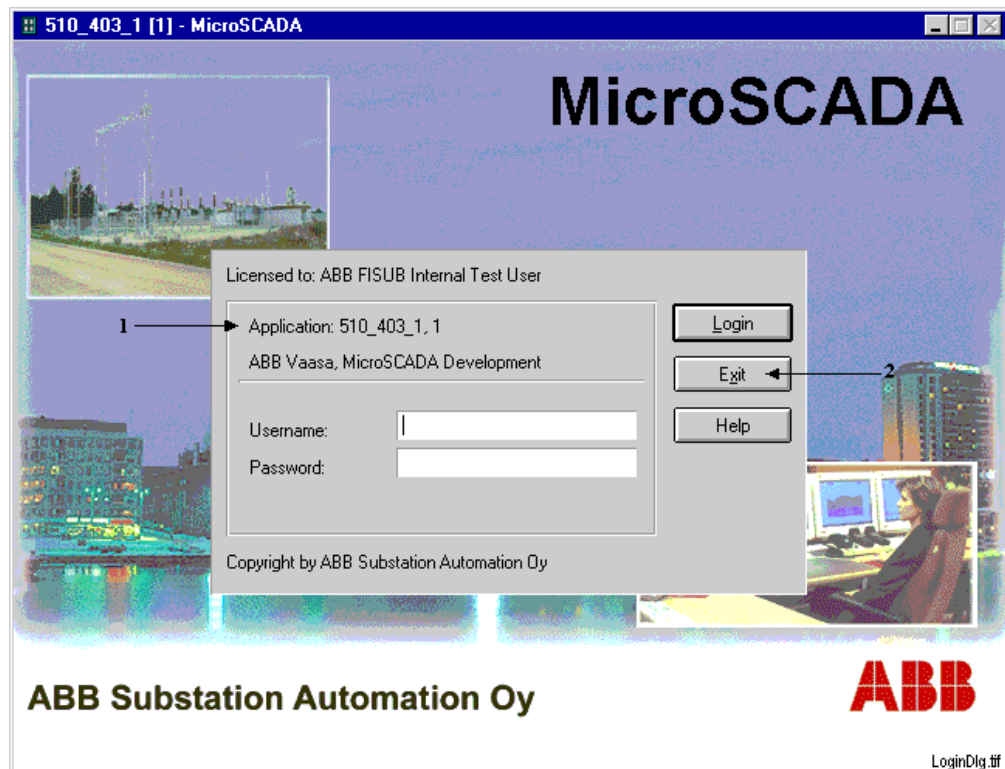


Figure 16. An example of the LIB 500 start picture with a login dialog

1. Application Name
2. Exit button to close the application window

1.13.1

User Login

In applications built with LIB 500, the start picture requests a user name and a password. Each MicroSCADA user name is associated with a certain user profile defined by the system manager.

The password is not displayed on the screen. If the user name and the password do not match, or the user name does not exist, the start picture re-appears and you can make a new attempt. Each attempt to log in is registered by the system (even attempts that fail).

If the login succeeded, the first picture is produced on the screen. All operations subsequently performed on the monitor or in the application window in question will be related to the authority profile associated with the user name. The user name will also be included as an identifier in the event register when certain manual operations are performed.

A new login or a logout can be performed any time in the start picture and in the login window which is accessed from the main menu.

In order to prevent anybody else from using your user name and authority profile, always logout or reset the authority level when leaving the control room.

1.13.2

Authorization

Each user name is associated with a certain user profile which may restrict the user's access to pictures or data. An additional dimension in the authorization mechanism is that the objects in process pictures can be freely grouped into authorization groups. This means that an user can have different authorization levels for different apparatuses. Users can also be defined to have different authorization levels for different substations etc.

Table 2 Applications built with LIB 500 provide the following four levels of user authorities:

Authorization level	Authorization Group	Remarks
0	View	The operator is allowed to view the functions but not to make control operations.
1	Control	The operator is allowed to make control operations, e.g. control of switching devices (limited rights).
2	Engineering	All rights are granted, excluding user management, which is dedicated to the system manager (all rights).
5	System Management	The user with this authority level is the system manager. All rights are granted, including the rights to add and remove users and authorization groups. Each application has only one system manager. The user that first logs into an application will be the system manager of that application.

If a standard function does not have an authorization group defined or the group is not included in the authorization definitions, then an authorization level from the predefined GENERAL group is used. Thus, the GENERAL group cannot be removed.

NOTE! System Tools are managed from an authorization group of their own called Tools. This means that the authorization group TOOLS must be defined in order to be able to dedicate the system tools to a certain user(s).

The system manager is the only one who is able to add and remove users and grant rights to the users. The password, however, is selected and may be changed by the user exclusively. This is done in the Change Password dialog.

The authorization level of the user will be reduced to the "View" level when a certain time (default = 8 hours) has elapsed since the last login.

1.13.3

Closing

Logging Out

In LIB 500 based applications logging out means that the user name and user authority are cleared. The user is logged out

- when the application is closed as described below
- when a new login is performed in the start picture or in the login window
- at emergency picture exit in X-monitor.

Time Based Logout

After a certain time has elapsed, e.g. 8 hours, an automatic logout is done. Logout duration is defined in Application Settings Picture, i.e. the setting is application specific. The user has to login again via the Login dialog found in the Main menu. The Main menu login is described earlier in the Main pull-down menu section.

Emergency Picture Exit

If you, for some reason, get into a locked situation where the Previous picture item cannot be applied, you can always exit the operated picture by means of an invisible function key, one character in size, in the upper left corner. This key is present on all screens and application windows, independently of the displayed picture. In order to use the emergency exit key:

- Click three times on the upper left corner.

First, on-going control commands in the picture are completed, though e.g. an on-going data entry is interrupted. Then the picture is exited and the picture that is defined as the first picture in your application is shown.

Depending on what kind of monitor that is used, emergency picture exit, returns to different start pictures. When using VS local or VS Remote monitors, the first picture after login is shown, while the X-monitor will show the login picture.

1.14

Shifting Pictures on Screen

Generally, shifting of picture functions on screen is obtained in any of the following manners:

- By advancing through menus displayed on screen.(see Stations example in next section)
- By selecting function keys in the picture functions.

The push buttons in the picture header is described in the section Push buttons in the picture header, while the basic pull-down menus are described in the section Picture header pull-down menus, all in this chapter. Picture function related menus and push buttons are described with corresponding description of the picture function, e.g. Event List, DR-Collector Tool etc.

Switching between station pictures is done from the Station menu by selecting the station to be opened. A station picture can be open on several monitors simultaneously.



This button opens the previously opened picture




This button opens the first picture

1.14.1

Navigating in the Pull-Down Menus

The stations menu will be used as an example of how to access the menu items and submenus provided by the pull-down menus. This example also shows how shifting between process pictures is done.

Generally the menu items are functions or process pictures. A pull-down menu contains one or several menu items.

The  after a menu item indicates that it is a cascade menu with more items.

The option that the mouse is pointing at or is the item selected is “lifted” compared to the environment.

Step 1

Select the menu from the menu bar in the picture header.

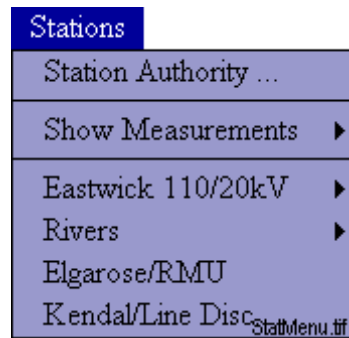


Figure 17. Selecting the Stations menu item

Step 2

Select a menu item in the pull-down menu.

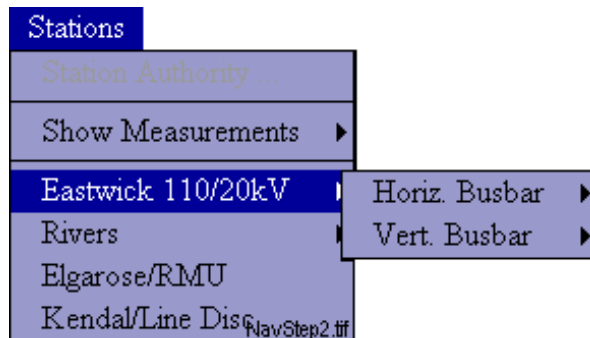


Figure 18. Selecting the Eastwick 110/20 kV station, containing several process picture, either in horizontal or in vertical form

Step 3

The items in the submenu are revealed, select with the mouse.

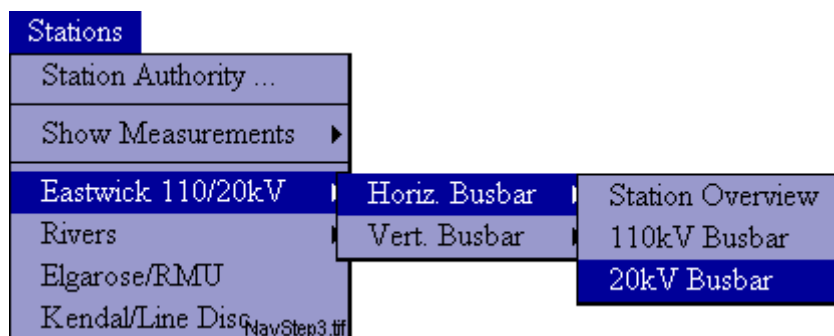


Figure 19. Selecting the 20 kV busbar item, which will be opened

1.15 Basic Handling of Application Pictures

1.15.1 General

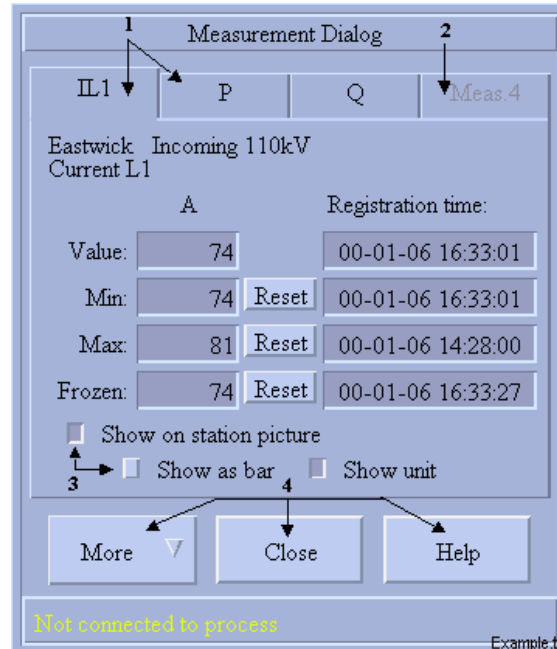


Figure 20. A picture containing folders, unavailable folder, selection buttons, and push buttons

1. Available folders
2. Unavailable (disabled) folder
3. Selection buttons
4. Push buttons

The principles for handling the elements listed in Figure 20 are applicable to all similar appearances regardless of the picture function.

In Figure 20 there are listed elements selected or activated by the mouse. When the function is dimmed, it is unavailable.

1.15.2 Push Buttons



Figure 21. Examples of push buttons

In order to execute a push button:

- Place the pointer on the button and click the left mouse button or press Enter on the keyboard. A key can be recognised by the shadows around the key and by the text attached upon the key.

The push button is activated when the button changes appearance and color so that it seems to be pressed down. When a push button is activated, the program or the data input of the button is executed from the beginning to the end. Meanwhile, no other push button can be applied.

Some push buttons like More are containing more items, which are selected by clicking on the desired menu item.



Figure 22. The More button is pressed

The More button contains various kind of functionality depending on from which dialog it is opened.

Upon pressing a push button a verification dialog is opened for all operations that are executing certain types of operation, e.g. opening a circuit breaker, raising of tap changer position etc.. The user is there after asked to confirm the operation, thus enabled to regret the operation. If the authorization of the user is not of enough high level, the push button is dimmed, or not available. The push button may also be unavailable or dimmed because of other ongoing processes or other conditions. Other operations carried out upon pressing push buttons is e.g. that sub menus are opened or directly starting another picture function etc.



Figure 23. Verifying the action to be performed

1.15.3

Folder



Figure 24. The folder labelled Page 1 is selected and active

To select a folder, you just place the mouse on the folder e.g. Page 2 and click the mouse button. The selected folder becomes active.

1.15.4

Selecting Options






Figure 25. Example of options with selection buttons

The options, both diamond and square, are also selected by the mouse. Press down the option to be active or selected. If you want to deselect or change a selection, then you have to press down an other option for the same setting, or in some cases another click toggles the state like on/off. The options may already be selected due to preconfigured or default settings. Depending on implementation one or several options  can be pressed down for the setting. Selecting of options can also be done vertically or horizontally, depending on where it is implemented.

Definitions and Examples

1a  is not pressed or selected

1b  means pressed down and selected.

2 One option may be more important than the rest:



Figure 26. Show on station picture is selected, which means that the two others can be changed



Figure 27. Show on station picture is no longer selected, which means that the other two are not in use, thus being unavailable.

1.15.5 Scroll Folders Arrow Buttons



Figure 28. Scroll arrows for left and right direction

Clicking on a scroll folders arrow button scrolls the folders rightward or leftward depending on the direction the arrow is pointing at. This function is used when the folders are more than what is applicable in one view.

1.15.6 Entering Data

Text and data are entered in input fields which appear in the picture. The system indicates with a horizontal blinking stroke or, in some cases, a vertical stroke, the input cursor, that it is waiting for a data entry. If there is previously entered data in the field, the character below the input cursor is flashing, and the text or data can be edited.

Typical situations when data is to be entered is in the SPA Relay Tool and RED Relay Tool for configuring relays and terminals, edit value limits dialog, for simulating off-line process values, in Trends etc.

In order to enter data:

- If the input cursor is not visible, initiate the input by pressing the input field or the input text.
- Type in the data using the keyboard or a soft key panel in the picture.

If the field contains previously entered data, a space or other character in the first character position will empty the rest of the field. In order to edit, but not remove, previous data, start by moving the input cursor.

- Complete the entry by pressing Enter on the keyboard. If the data entry comprises several fields, an automatic activation of the following field is achieved by pressing Enter or by clicking ENTER using a certain mouse button.

As long as the input cursor is seen, the system is waiting for additional data. As a rule, no push buttons other than character keys, cursor positioning keys DEL, BACKSPACE and ENTER can be applied. However, the emergency exit key can be used, as well as certain push buttons (push buttons which perform the ENTER as the first command). During data entry, all updating in the picture pauses.

The input fields are intended for either numerical data or texts.

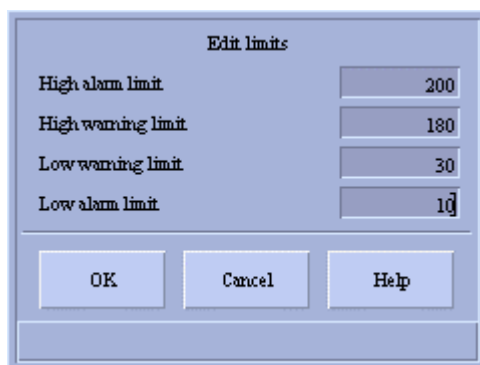


Figure 29. Edit limits, which is a typical function for the MV process

1.15.7 Moving Dialogs

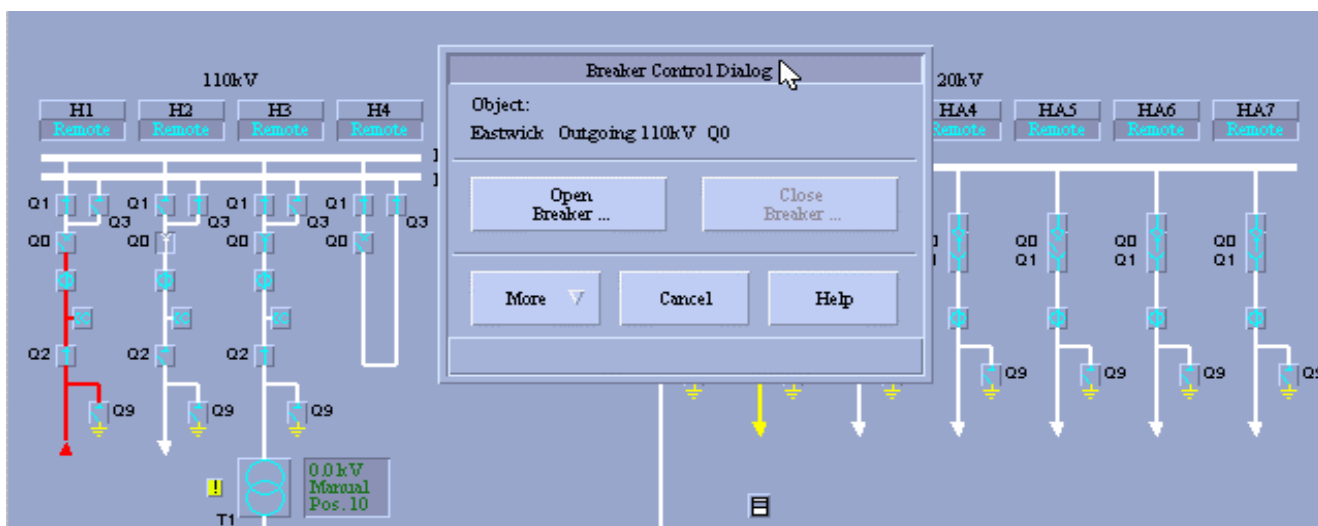


Figure 30. Picture header items


Push buttons which are hidden under a dialog cannot be activated when they are covered. Therefore, many dialogs are supplied with a feature for moving them from one location to another. In order to move a dialog:

- Click the header of the dialog
- Hold down the left mouse key on the header of the dialog.
- Drag the dialog to the new location.

The dialog is now moved to the new location. However, the move is not permanent. The dialog remains on its new location only as long as the picture is displayed on the screen.

1.15.8 Viewing HELP Texts

When there is a HELP button in the picture or in a dialog, help texts is accessed as follows:

- Press the HELP button in the picture or in the dialog.
- Press the question mark symbol 

A dialog with information of the entire picture or function is shown. The HELP dialog is closed by pressing CLOSE.

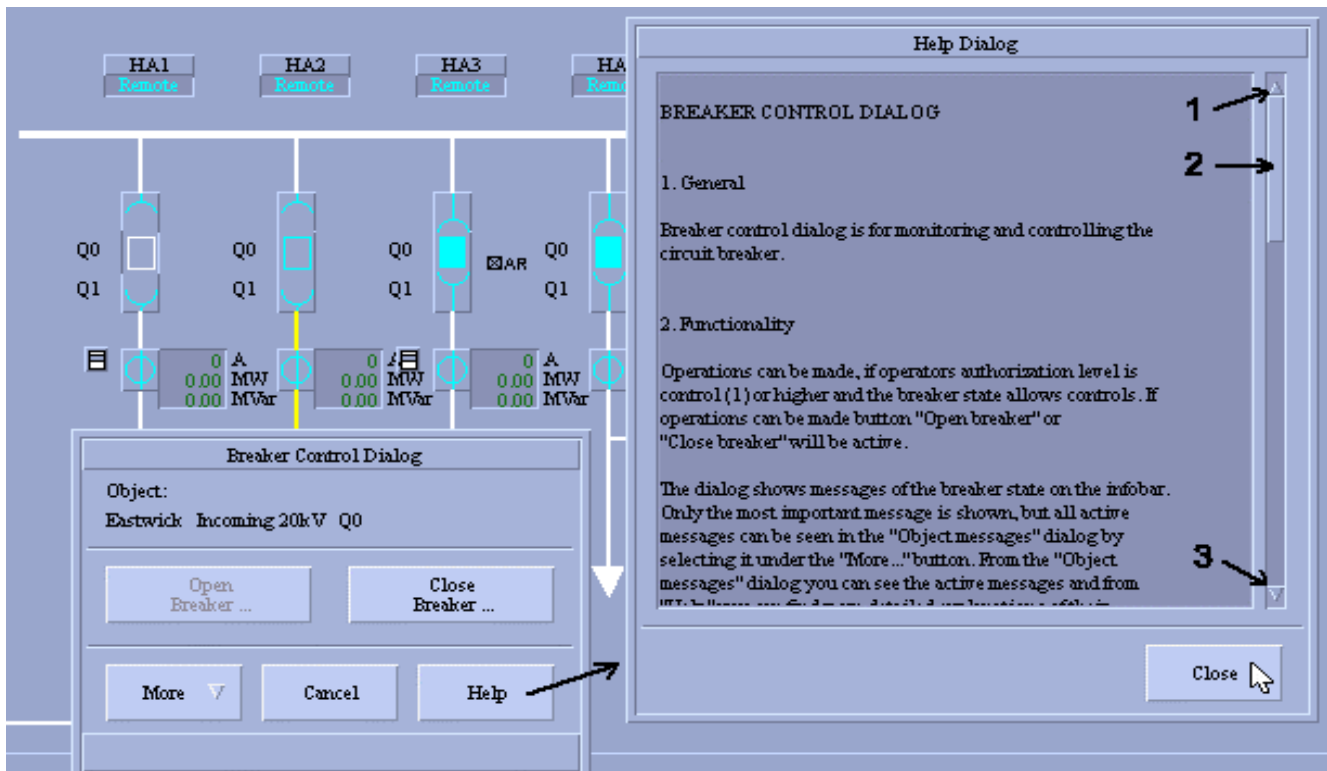


Figure 31. Showing help texts

Table 3 Explanations to the numbers in Figure 31:

Number in figure	Meaning
1	Scroll arrow upwards
2	Scroll box
3	Scroll arrow downwards

1.15.9 Inquiring Picture Name

In order to view the name of the main picture currently shown on the screen or in the application window:

- Click twice on the upper left corner.

The picture name is shown in the upper left corner. You can remove the name by clicking it.

1.16

Some Terms Used in the Operator's Manual

Term	Explanation
Application or customer application	All the processes and views included in an application. Normally an application consists of an overview or first picture and several process pictures and application pictures.
Application picture	An application picture is a picture giving you a quick overview of the application, e.g. an Overview picture or a System picture. A station picture is a picture showing a specific station where see the processes in the station. A process picture is a picture showing a specific process in a station. In a very small application they can all be the same.
Attribute	Attributes are containing the settings and definitions for the properties for the picture functions and are stored in the process data base.
Authorization	Different users can have different access rights to the same picture functions and processes.
Authorization level	Different levels of authorization gives the users different types of access, like view, control operations, system manager etc.
Authorization group	Picture functions and application pictures can be grouped into authorization groups, thereby requiring a certain authorization level of the user for e.g. control operations
Dialog	A dialog is a two-way communication box between the user and the system. The dialog informs the user about what is happening, help texts, what can be done, which functions to be executed etc. The user responds by selecting the appropriate push button.
First picture	The picture that is the first picture that is opened after the login, also the one that push button 3 in Figure 3 opens.
Library function	A library function is a function that with in a software package is a ready made function that only need configuration of the attributes.
LIB 500	LIB 500 contains the needed base functionality for installing support packages like LIB 510, LIB 5xx... LIB 500 also provides functionality like the Event list, Alarm list, Busbar coloring etc.

LIB 510	LIB 510 is a support package containing the library functions for using e.g. MV process functions, Trend reports, SPA Relay Tool, RED Relay Tool, DR-Collector Tool.
Monitor	A monitor is the definition of the screen where the application window is to be opened and the size of it, (12-15 or 16-20 size). The type of monitor is also determined, VS-Local, VS-Remote or X-Monitor.
MicroSCADA session	The whole operation from starting up the system, performing login to running of the system with its customer application to ending the session.
Menu item	The available options that are listed when opening a pull-down menu.
MFU	Multi-function unit, such as relays, terminals etc.
MV Process	Medium Voltage functions like Circuit breaker, Transformer, Three state switch, Station, Bay etc. used as picture functions in the process pictures.
Process data base	A data base containing the individual process objects and related attributes.
Process object	A process object is some defined picture function like disconnector
Process picture	A type of an application picture containing process objects (e.g. MV Process picture functions), which are connected to the processes. In the process picture, e.g. measurements, and the states of disconnectors and breakers are normally updated, and switching devices can be operated.
Picture function	The functionality is built in with the application picture presented on the monitor. However, the application picture can contain not only one or several different picture functions, but also several similar ones, for example disconnectors, transformers etc.
Representation symbol	The symbol used for a picture function, e.g. circuit breaker, transformer, measurement, relay etc. The representation symbol is selected during the configuration of the picture function.
Picture specific area	An area where process specific functions are presented.
Push button	Typical push buttons are buttons like OK, Cancel, Help, More, Close etc. Upon pointing at the push button and then clicking the (left) mouse button, the action behind the push button is performed. Dialogs are typical providers of push buttons.
Station picture	A type of an application picture, which gives an overview of the processes in a station. The station picture is often designed according to a single line diagram, e.g. with MV Process picture functions.
Switching device	Devices in the MV process, that can be operated like circuit breaker, three state switch, transformer etc.