



We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

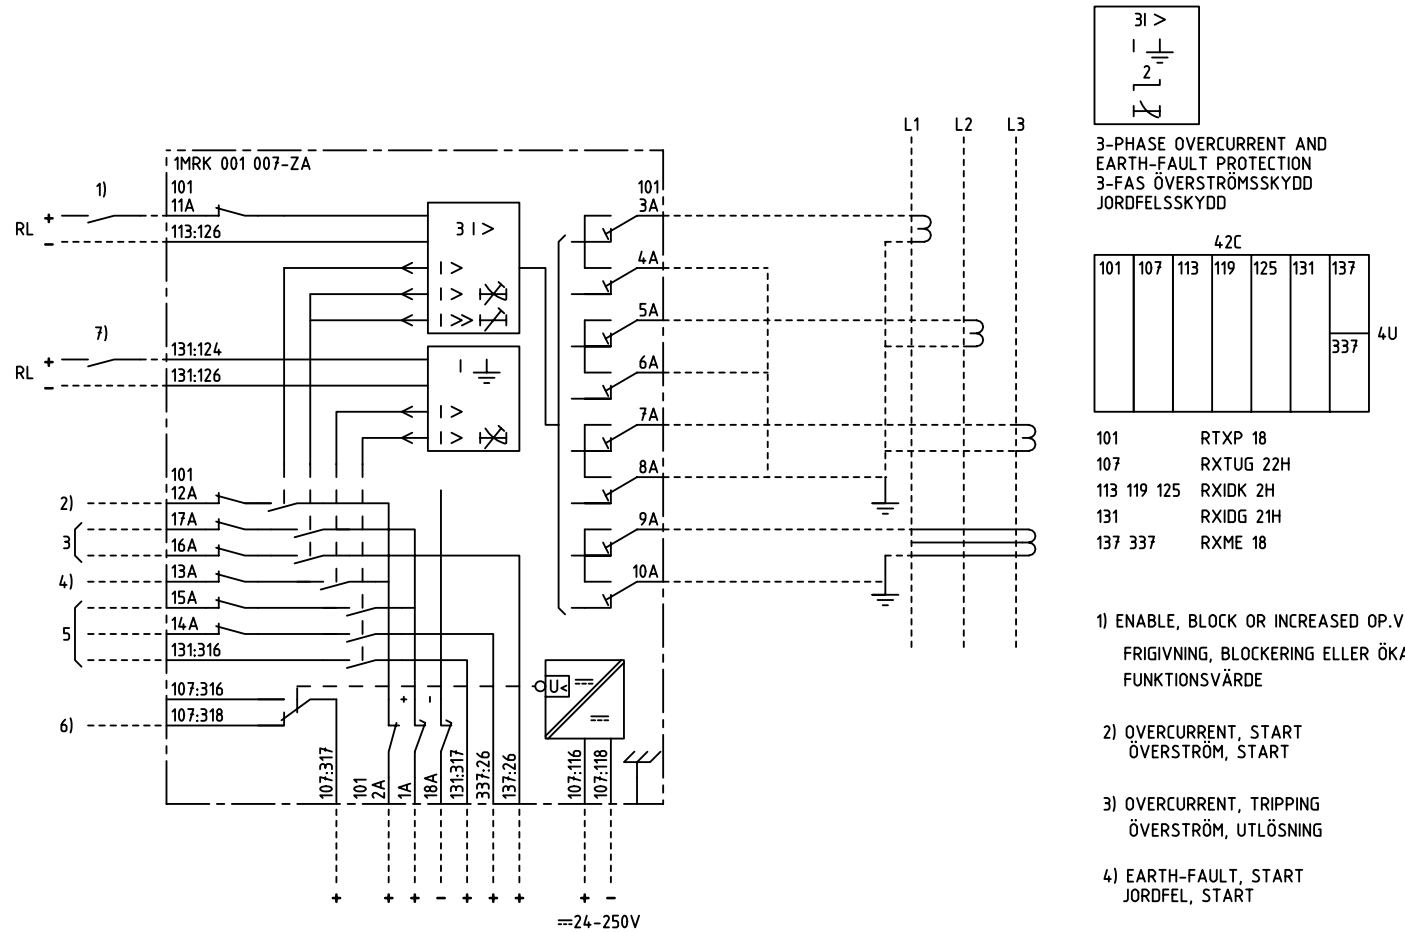

3-PHASE OVERCURRENT AND
 EARTH-FAULT PROTECTION
 3-FAS ÖVERSTRÖMSSKYDD
 JORDFELSSKYDD

| 42C | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|
| 101 | 107 | 113 | 119 | 125 | 131 | 137 |
| | | | | | | 337 |
| | | | | | | 4U |

- 101 RTXP 18
- 107 RXTUG 22H
- 113 119 125 RXIDK 2H
- 131 RXIDG 21H
- 137 337 RXME 18

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE
FRIGVNING, BLOCKERING ELLER ÖKAT
FUNKTIONSVÄRDE
- 2) OVERCURRENT, START
ÖVERSTRÖM, START
- 3) OVERCURRENT, TRIPPING
ÖVERSTRÖM, UTLÖSNING
- 4) EARTH-FAULT, START
JORDFEL, START
- 5) EARTH-FAULT, TRIPPING
JORDFEL, UTLÖSNING
- 6) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING
- 7) ENABLE OR BLOCK
FRIGVNING ELLER BLOCKERING

ELCAD ID PS/render DATE 2004-06-224:52

Issued in ARCADE

| | | | | | | | | | |
|-----------------------------|----------|--------------------------------|---------|-----------------------------------|--|-------------------------|--|---------|--|
| Prepared 97-03-18 H RAZA/JE | | CIRCUIT DIAGRAM/KRETSSCHEMA | | Resp dep PS | | Rev ind 1 98-08-10 | | Lang 82 | |
| Approved 97-04-02 P JENÄKER | | RACIK 4 OVERCURRENT PROTECTION | | Sheet 1 | | | | | |
| | | RACIK 4 ÖVERSTRÖMSSKYDD | | Cont | | | | | |
| Rev Ind | Revision | Reg No | 7411 | ABB ABB Network Partner AB | | 1MRK 001 007-ZAA | | | |
| Based on | | Pcl | 890.616 | | | | | | |