



We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

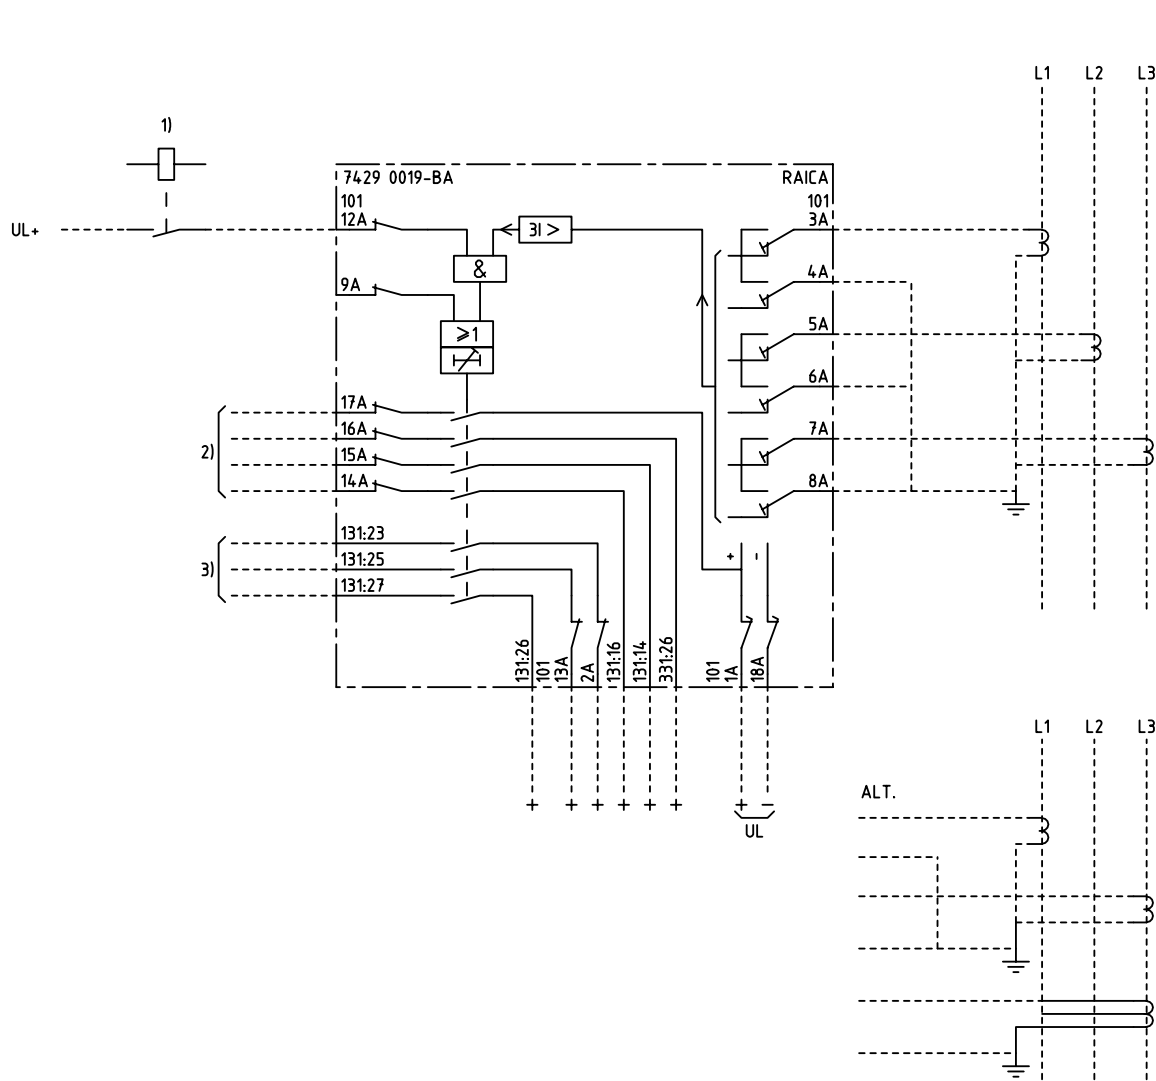

BREAKER FAILURE PROTECTION  
 WITH ONE TIME STEP,  
 CURRENT DETECTORS IN 3-PHASES  
 OR IN 2-PHASES + EARTH

BRYTARFELSSKYDD MED ETT TIDSTEG,  
 STRÖMRELÄER I TRE-FASER  
 ELLER I 2-FASER + JORD

- 1) TRIP RELAY IN ANOTHER PROTECTION  
UTLÖSNINGSRELÄ I ANNAT SKYDD
- 2) TRIPPING OF BACK-UP CIRCUIT BREAKERS  
UTLÖSNING AV RESERVBRYTARE
- 3) ALARM ETC.  
SIGNAL M.M

ELCAD ID TPTD/render		DATE 2004-06-221:41		Issued in ARCADE	
Prepared 88.35		C-H EINVALL		TERMINAL DIAGRAM/UTTAGSSCHEMA	
Approved 88.35		Peter Jenøker		RAICA BREAKER FAILURE PROTECTION	
				BRYTARFELSSKYDD	
Rev Ind	Revision	Reg No	7429	Resp dep	TPTD
Based on		Pct	890.651	Rev ind	2 96.45
				Lang	82
				Sheet	1
				Cont	

**ABB** ABB Network Partner AB

**7429 0019-BAA**