


We reserve all rights in this document and in the information contained therein. Reproduction, use in other documents or translation into other languages is strictly forbidden. © ABB Automation Technologies AB

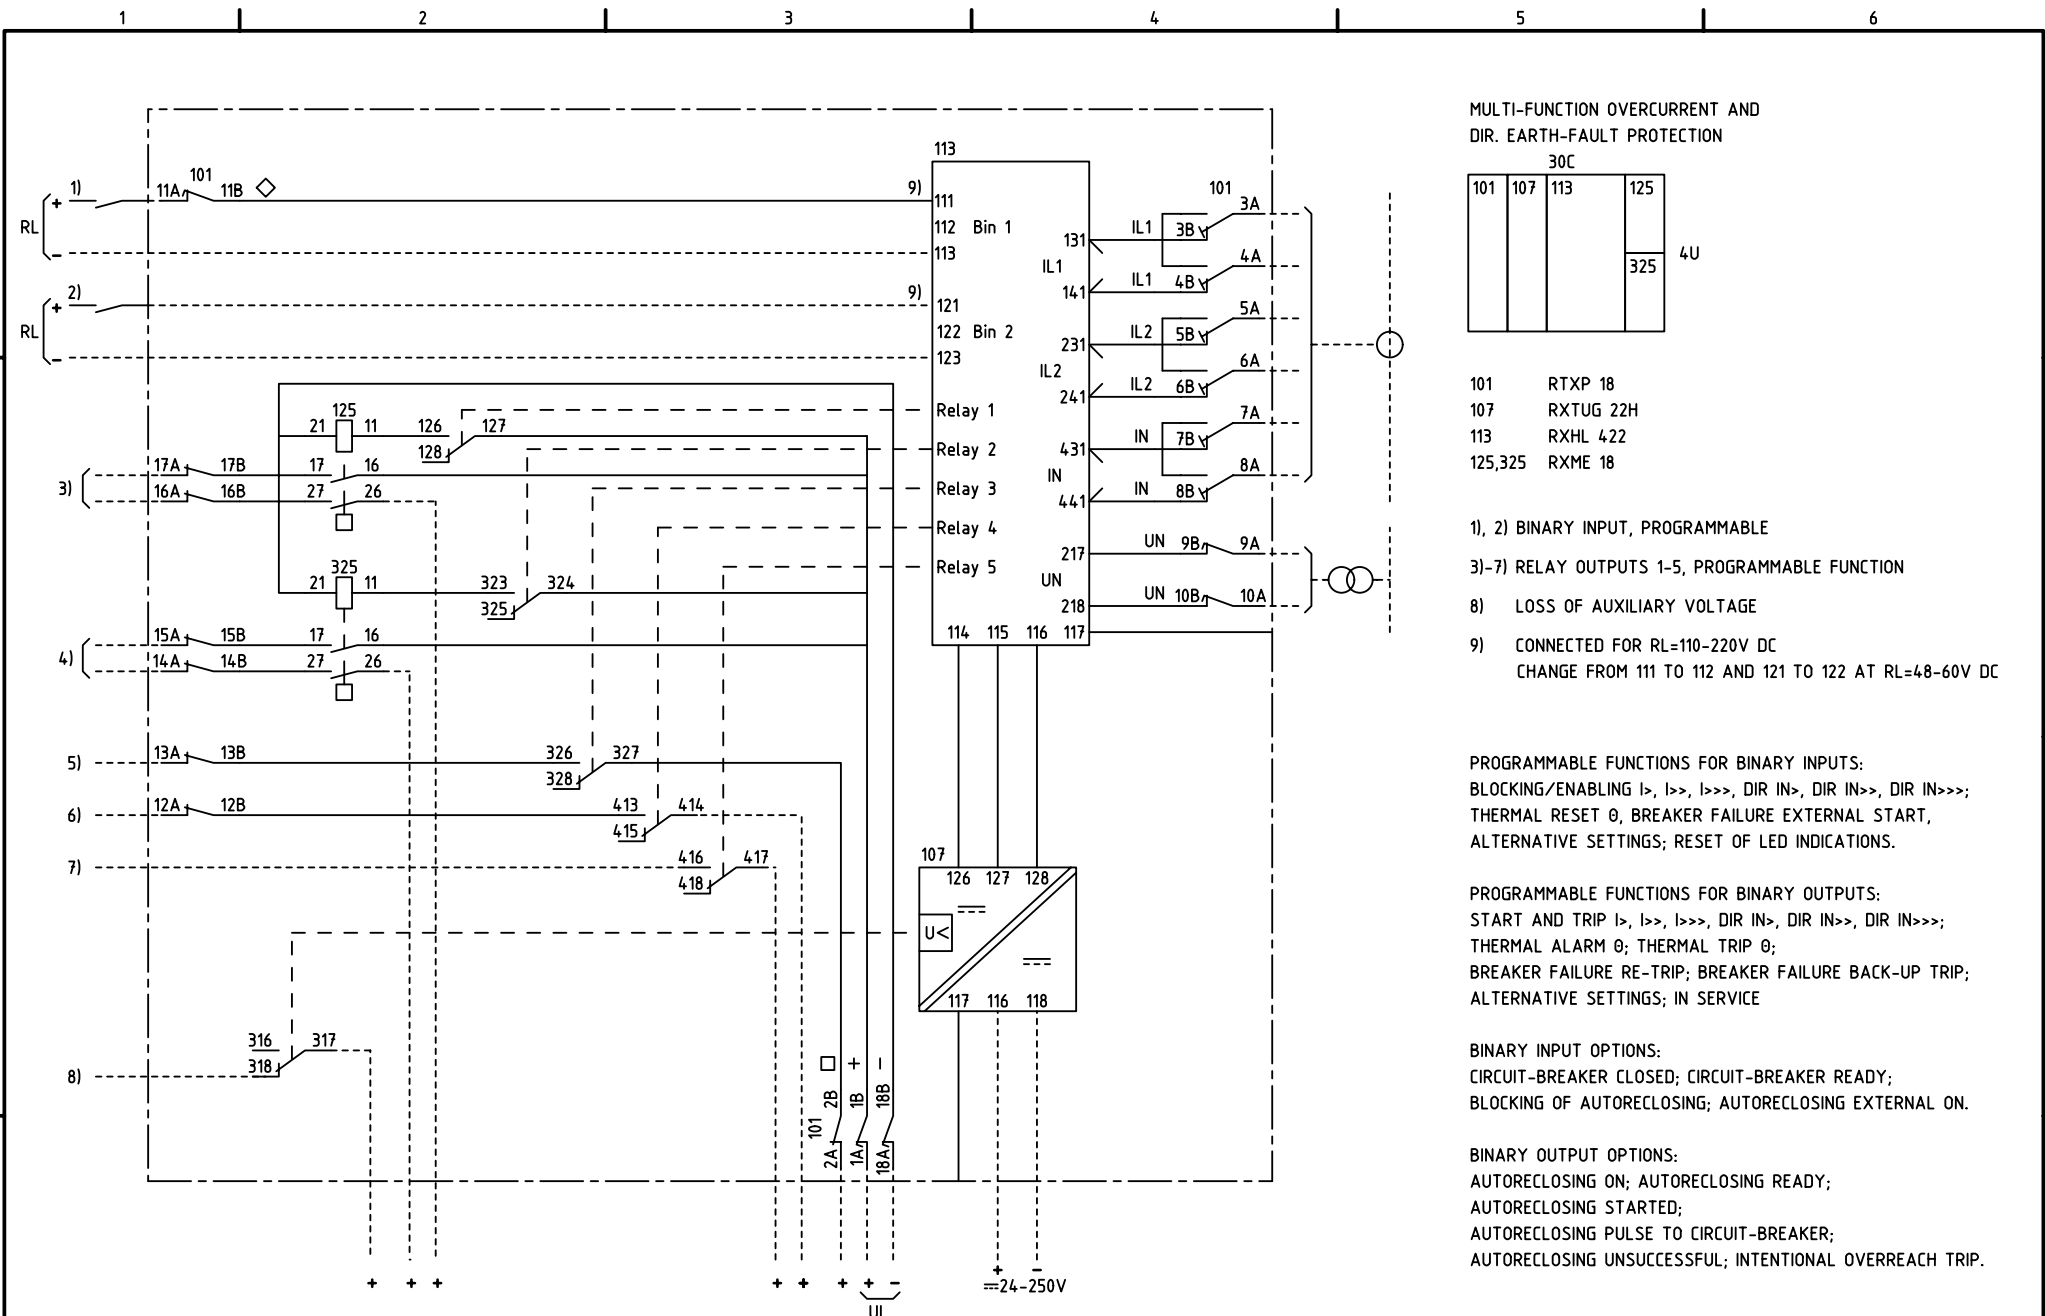

MULTI-FUNCTION OVERCURRENT AND DIR. EARTH-FAULT PROTECTION

30C			
101	107	113	125
			325
4U			

- 101 RTXP 18
- 107 RXTUG 22H
- 113 RXHL 422
- 125,325 RXME 18

- 1), 2) BINARY INPUT, PROGRAMMABLE
- 3)-7) RELAY OUTPUTS 1-5, PROGRAMMABLE FUNCTION
- 8) LOSS OF AUXILIARY VOLTAGE
- 9) CONNECTED FOR RL=110-220V DC
CHANGE FROM 111 TO 112 AND 121 TO 122 AT RL=48-60V DC

PROGRAMMABLE FUNCTIONS FOR BINARY INPUTS:
BLOCKING/ENABLING I>, I>>, I>>>, DIR IN>, DIR IN>>, DIR IN>>>;
THERMAL RESET 0, BREAKER FAILURE EXTERNAL START,
ALTERNATIVE SETTINGS; RESET OF LED INDICATIONS.

PROGRAMMABLE FUNCTIONS FOR BINARY OUTPUTS:
START AND TRIP I>, I>>, I>>>, DIR IN>, DIR IN>>, DIR IN>>>;
THERMAL ALARM 0; THERMAL TRIP 0;
BREAKER FAILURE RE-TRIP; BREAKER FAILURE BACK-UP TRIP;
ALTERNATIVE SETTINGS; IN SERVICE

BINARY INPUT OPTIONS:
CIRCUIT-BREAKER CLOSED; CIRCUIT-BREAKER READY;
BLOCKING OF AUTORECLOSING; AUTORECLOSING EXTERNAL ON.

BINARY OUTPUT OPTIONS:
AUTORECLOSING ON; AUTORECLOSING READY;
AUTORECLOSING STARTED;
AUTORECLOSING PULSE TO CIRCUIT-BREAKER;
AUTORECLOSING UNSUCCESSFUL; INTENTIONAL OVERREACH TRIP.

1MRK 001 994-CA

Customer drw no	Prep. PTUA/ TPTD H Raza/JE 2000-05-29	Circuit Diagram	Cont. sh/ No of sh			
	Appr. PTUA/ Roger Karlsson 2000-05-29			Multi-funct current prot		
	Resp. dept PTUA/ TPTD					
Based on	ABB ABB Automation Technologies		Document number 1MRK001995-CA	Lang. en	Rev. A	Sheet 1

Document status: Approved