




We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

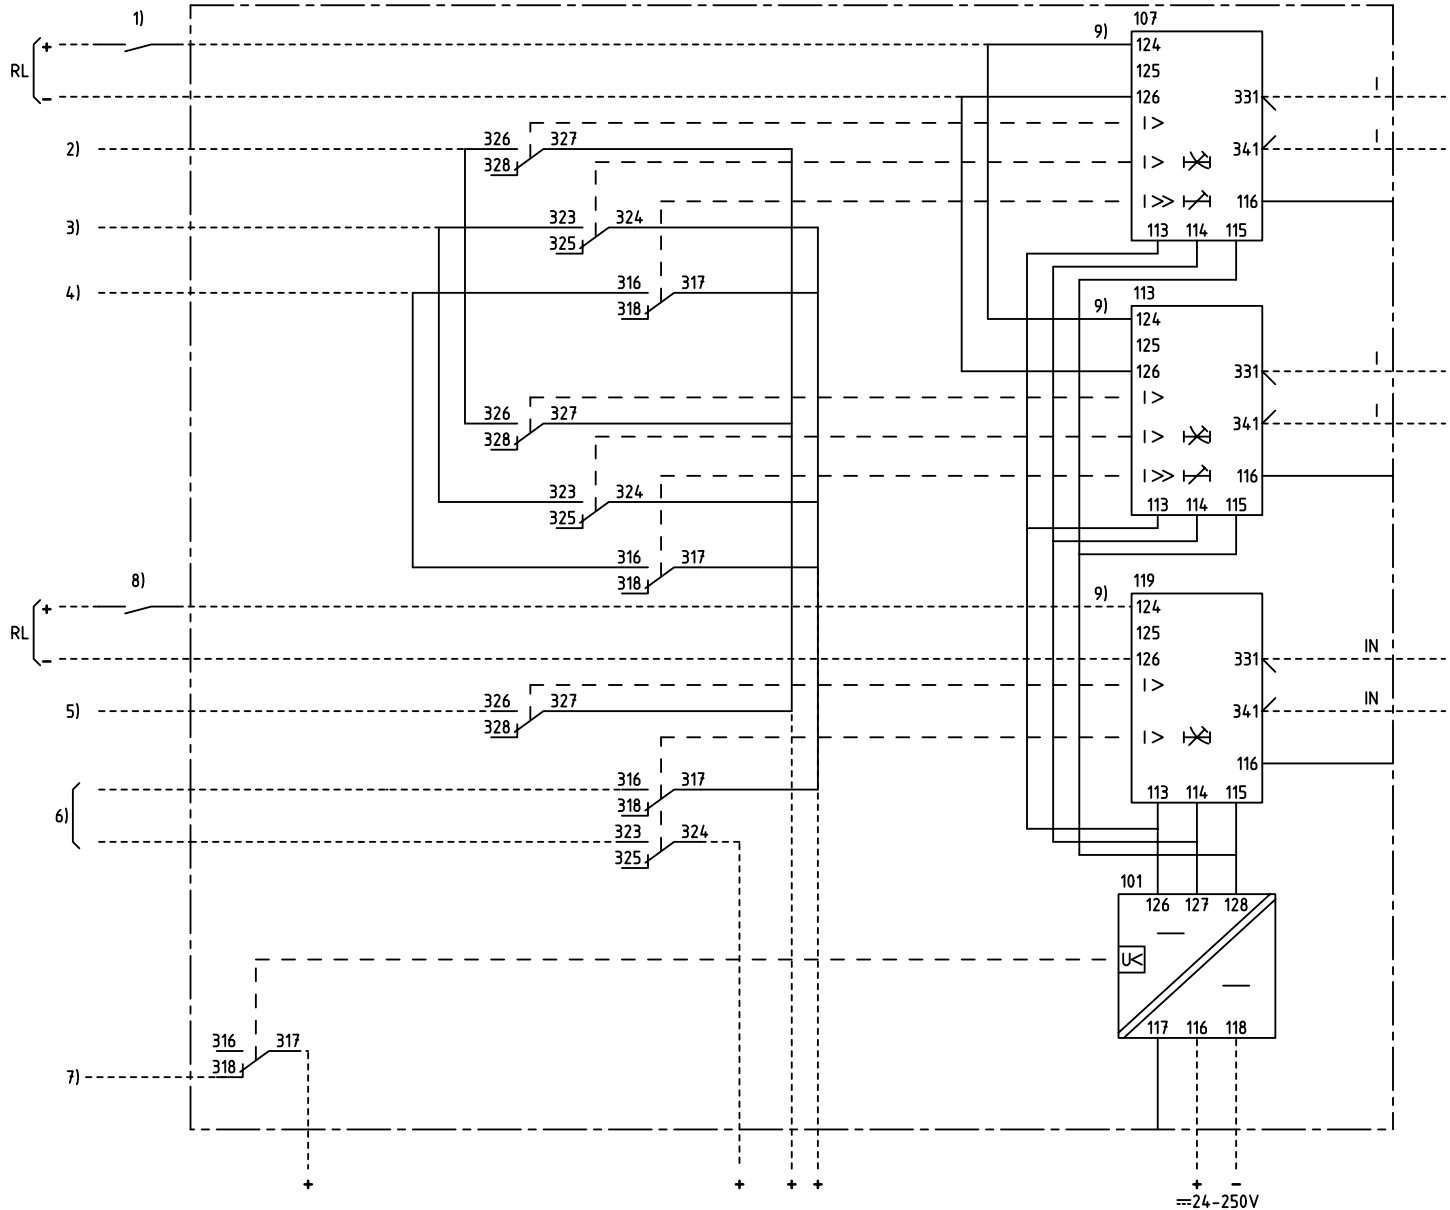

2-PHASE OVERCURRENT AND EARTH-FAULT PROTECTION  
2-FAS ÖVERSTRÖMSKYDD OCH JORDFELSSKYDD



101 RXTUG 22H  
107,113 RXIDK 2H  
119 RXIDG 21H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE FRIGIVNING, BLOCKERING ELLER ÖKAT FUNKTIONSVÄRDE
- 2) START, OVERCURRENT START, ÖVERSTRÖM
- 3) LOW SET STAGE, TRIPPING LÅGSTRÖMSSTEG, UTLÖSNING
- 4) HIGH SET STAGE, TRIPPING HÖGSTRÖMSSTEG, UTLÖSNING
- 5) START, EARTH-FAULT START, JORDFEL
- 6) EARTH-FAULT, TRIPPING JORDFEL, UTLÖSNING
- 7) LOSS OF AUXILIARY VOLTAGE BORTFALL AV HJÄLPPSPÄNNING
- 8) ENABLE OR BLOCK FRIGIVNING ELLER BLOCKERING
- 9) CONNECTED FOR RL=110-220V DC CHANGE FROM 124 TO 125 AT RL=48-60V DC KOPPLAD FÖR RL=110-220V DC ÄNDRA FRÅN 124 TO 125 VID RL=48-60V DC

ELCAD ID PAT/render

DATE 2004-06-222:00

1MRK 001 006-YA

Issued in ARCADE

Prepared 97-01-27 H RAZA/L OLSTAM		CIRCUIT DIAGRAM/KRETSSCHEMA			
Approved 97-03-10 P JENÄKER		RACIK 3 OVERCURRENT AND E/F PROTECTION			
		RACIK 3 ÖVERSTRÖMS- OCH JORDFELSSKYDD		Resp dep PAT	Rev ind 1
Rev Ind	Revision	Reg No 7411	<b>ABB</b> ABB Network Partner AB		<b>1MRK 001 007-TA</b>
Based on	Pct 890.616				
					Cont