


We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written permission of ABB Automation Technologies AB is strictly forbidden.

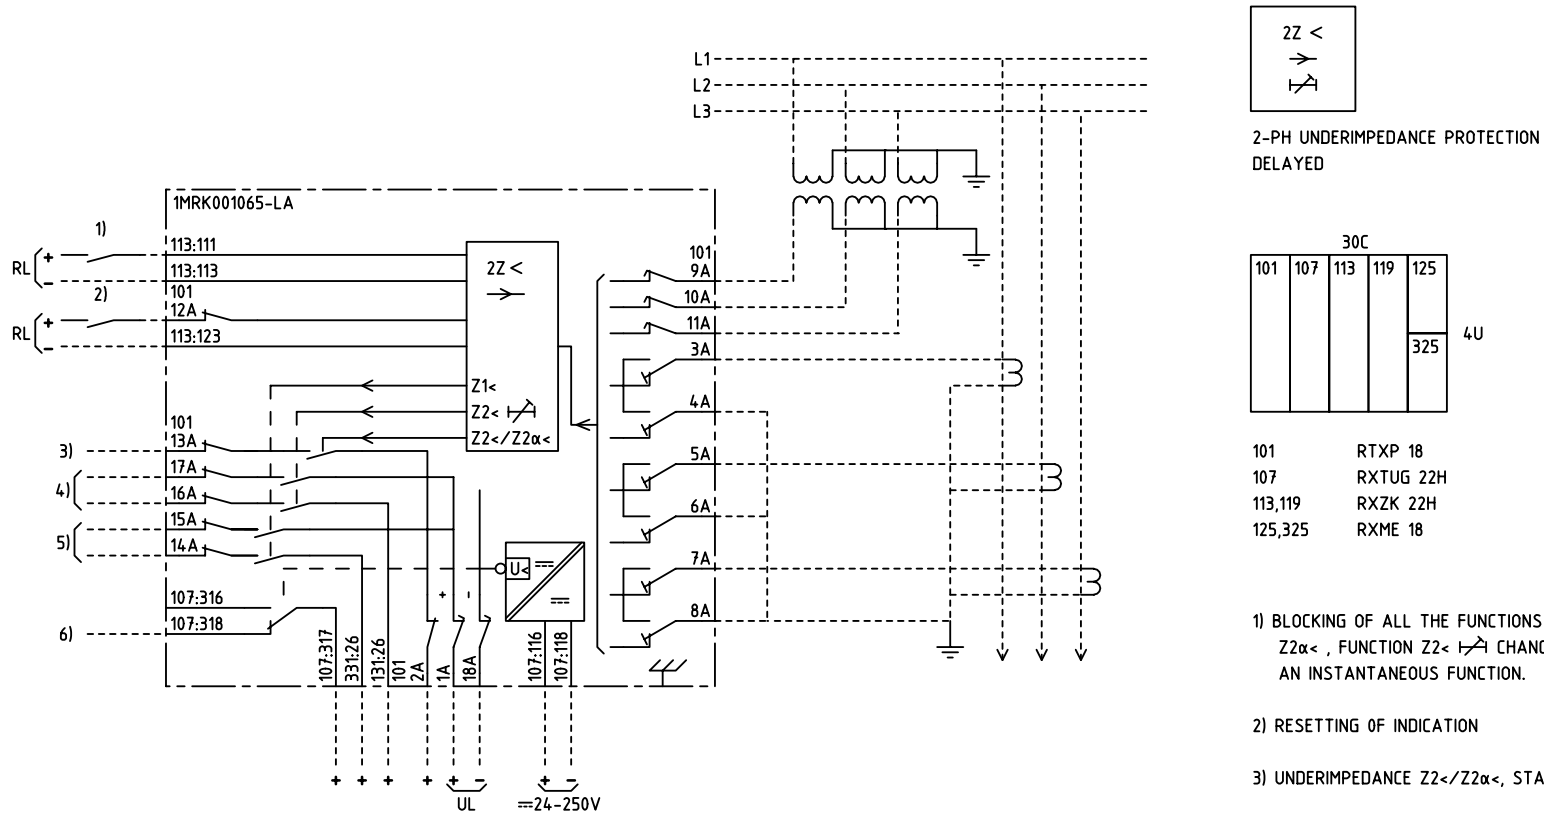

2-PH UNDERIMPEDANCE PROTECTION DELAYED

30C					4U
101	107	113	119	125	
				325	

101	RTXP 18
107	RXTUG 22H
113,119	RXZK 22H
125,325	RXME 18

- 1) BLOCKING OF ALL THE FUNCTIONS EXCEPT Z2α<, FUNCTION Z2< CHANGES TO AN INSTANTANEOUS FUNCTION.
- 2) RESETTING OF INDICATION
- 3) UNDERIMPEDANCE Z2</Z2α<, START
- 4) UNDERIMPENANCE Z2<, TRIPPING
- 5) UNDERIMPEDANCE Z1<, TRIPPING
- 6) LOSS OF AUXILIARY VOLTAGE

Customer drw no	Prep. PTUA/ TATD Eriksson Jill 2000-11-24	Connection Diagram	Conf. sh/ No of sh
	Appr. PTUA/ TATD Karlsson Roger 2001-03-27		
	Resp. dept PTUA/ PTUA/TPTD	Document number	Lang.
Based on	ABB ABB Automation Technologies	1MRK001065-LAA	en
		Rev.	Sheet
		-	1

Document status: Approved