




We reserve all rights in this document and in the information contained therein. Reproduction, use or distribution of this document without the written authority of ABB Automation Technologies AB is strictly forbidden.

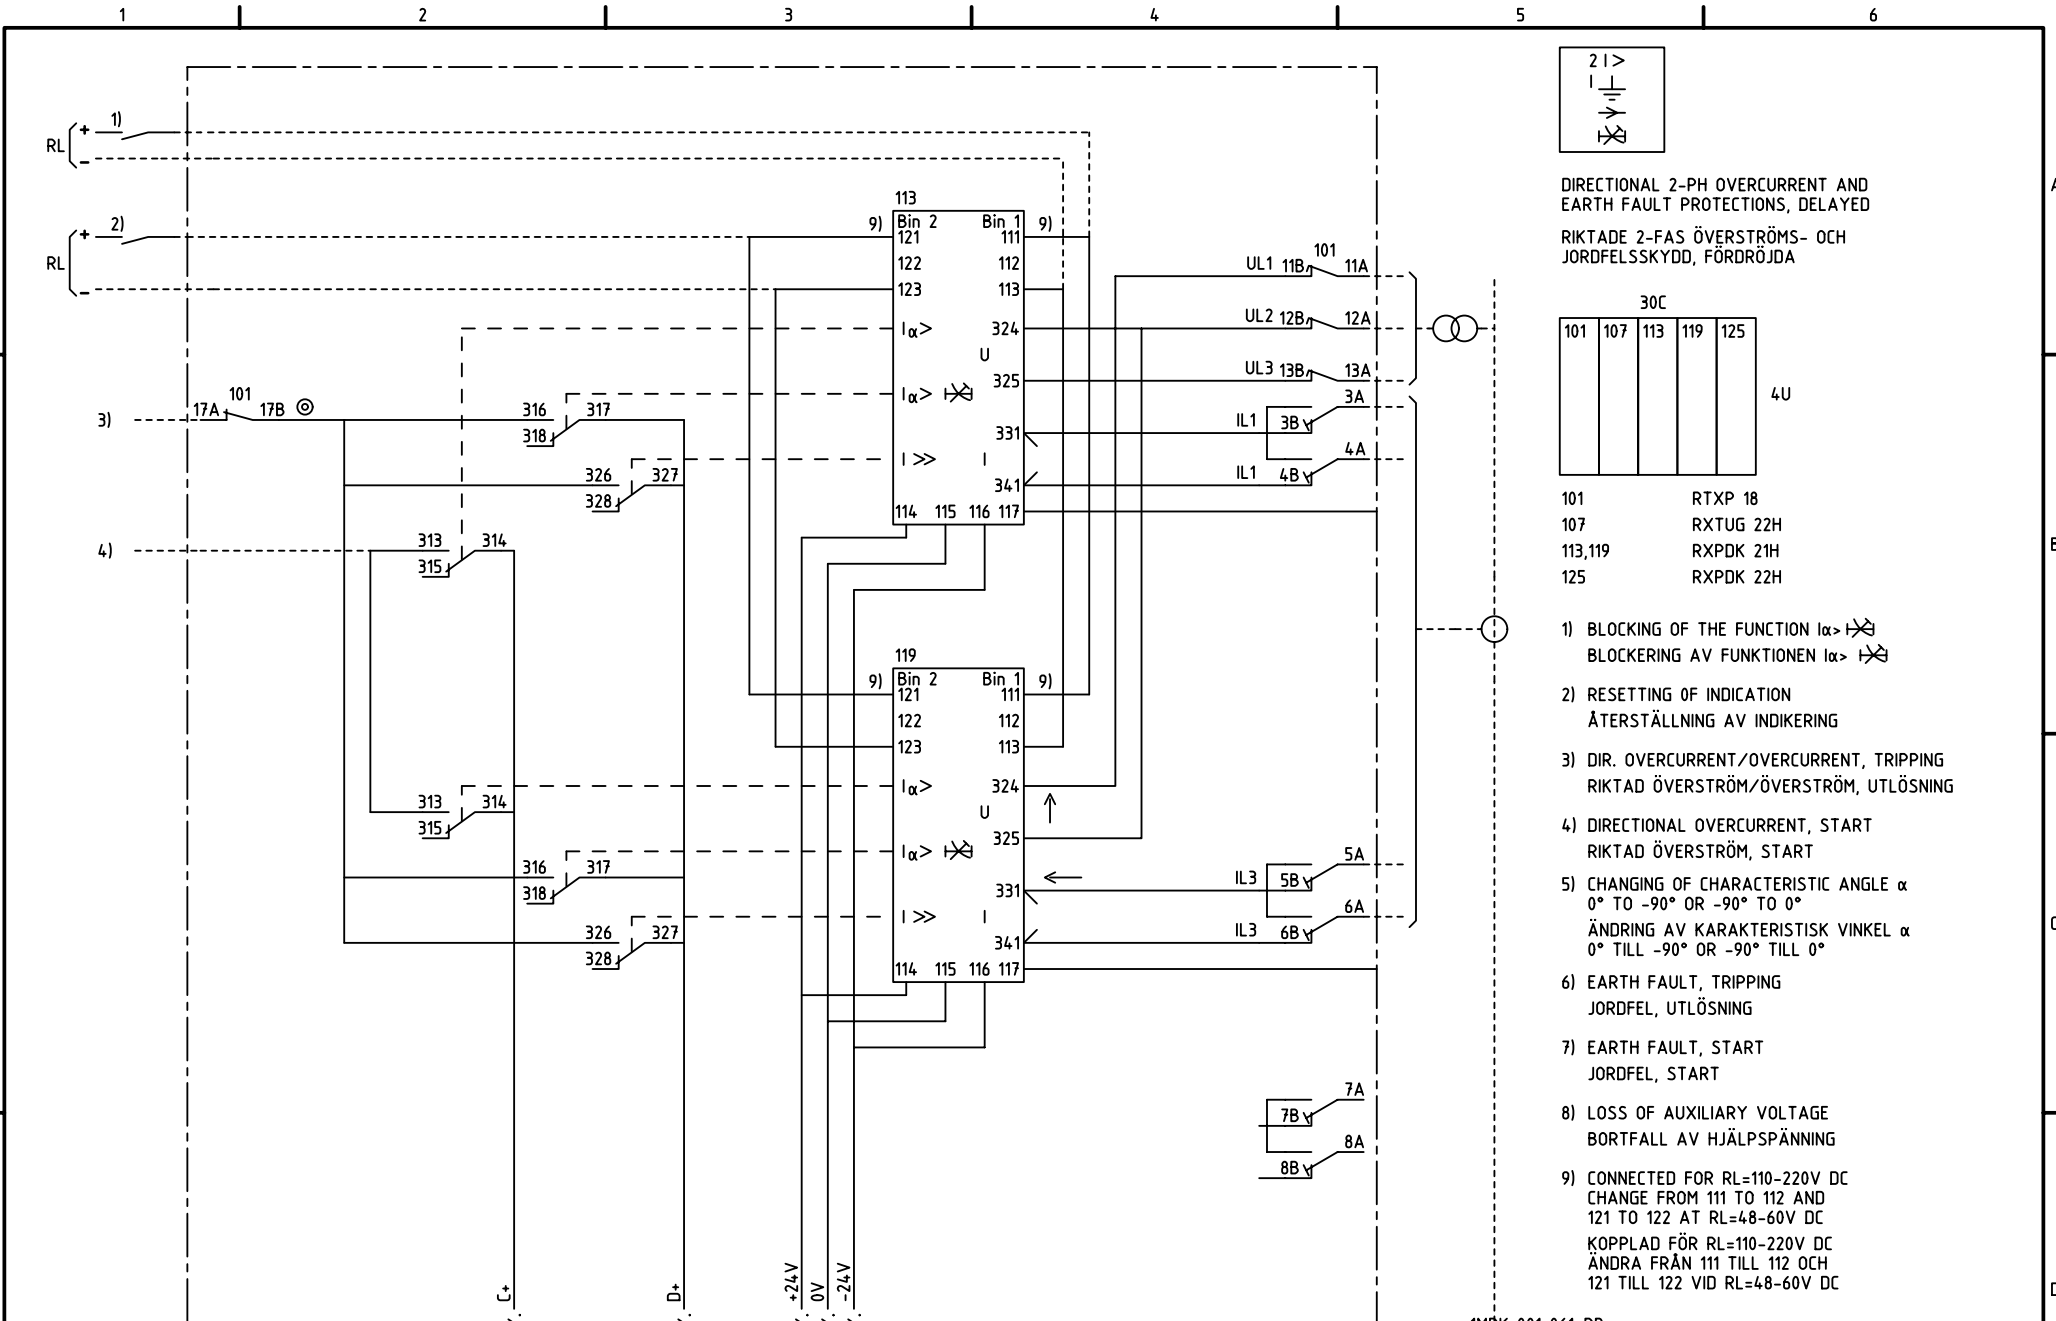

DIRECTIONAL 2-PH OVERCURRENT AND EARTH FAULT PROTECTIONS, DELAYED  
RIKTADE 2-FAS ÖVERSTRÖMS- OCH JORDFELSSKYDD, FÖRDRÖJDA



101 RTXP 18  
107 RXTUG 22H  
113,119 RXPKD 21H  
125 RXPKD 22H

- 1) BLOCKING OF THE FUNCTION  $I_{\alpha>}$  / BLOCKERING AV FUNKTIONEN  $I_{\alpha>}$
- 2) RESETTING OF INDICATION / ÅTERSTÄLLNING AV INDIKERING
- 3) DIR. OVERCURRENT/OVERCURRENT, TRIPPING / RIKTAD ÖVERSTRÖM/ÖVERSTRÖM, UTLÖSNING
- 4) DIRECTIONAL OVERCURRENT, START / RIKTAD ÖVERSTRÖM, START
- 5) CHANGING OF CHARACTERISTIC ANGLE  $\alpha$  0° TO -90° OR -90° TO 0° / ÄNDRING AV KARAKTERISTISK VINKEL  $\alpha$  0° TILL -90° OR -90° TILL 0°
- 6) EARTH FAULT, TRIPPING / JORDFEL, UTLÖSNING
- 7) EARTH FAULT, START / JORDFEL, START
- 8) LOSS OF AUXILIARY VOLTAGE / BORTFALL AV HJÄLPSPÄNNING
- 9) CONNECTED FOR RL=110-220V DC CHANGE FROM 111 TO 112 AND 121 TO 122 AT RL=48-60V DC / KOPPLAD FÖR RL=110-220V DC ÄNDRA FRÅN 111 TILL 112 OCH 121 TILL 122 VID RL=48-60V DC

1MRK 001 061-PB

Customer draw no.	Prep. PTUA/ TPTD H Raza/KJ 1999-03-29	Circuit Diagram	Cont. sh/ No of sh
	Appr. PTUA/ Roger Karlsson 1999-06-01	Dir. O/C and E/F prot.	2
	Resp. dept PTUA/ TPTD	Document number	Sheet
	<b>ABB</b> ABB Automation Technologies	1MRK001062-PB	1
Based on		Lang. 82	Rev. -

Document status: Approved

